

8 7 6 5 4 3 2 1

D

C

B

A

1 2 3 4 5 6 7 8

E

F

G

H

I


J

D

C

B

A

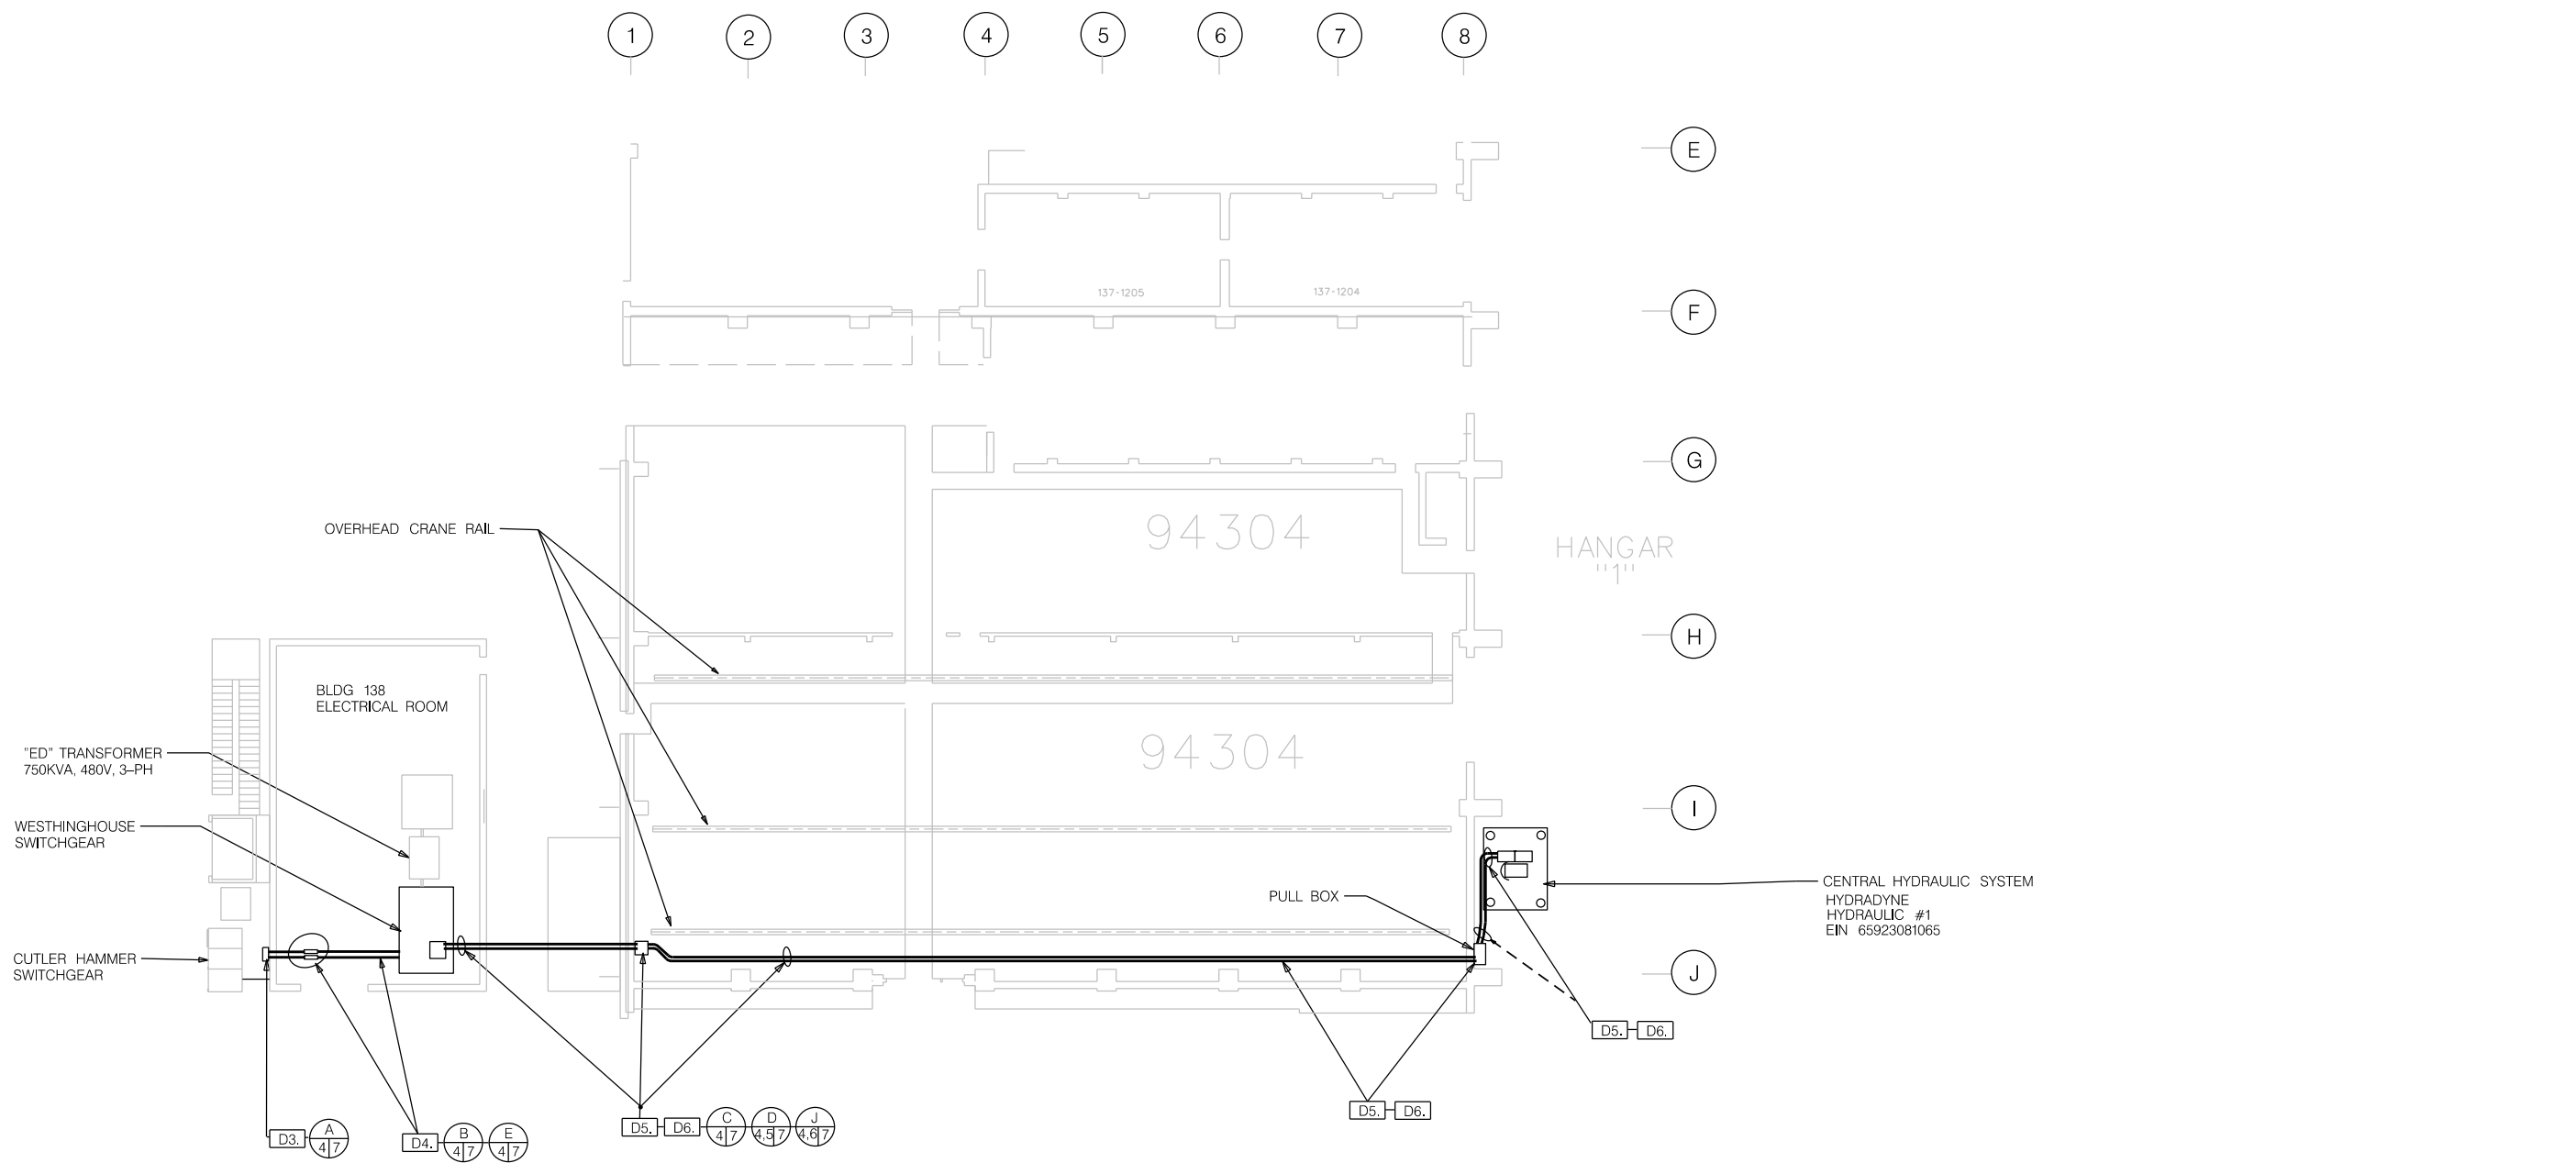

EXISTING – PARTIAL PLAN VIEW
SCALE: NOT TO SCALE




DEMOLITION NOTES:

- D1. ALL WORK ON THIS PROJECT SHALL BE ACCOMPLISHED IN A MANNER THAT WILL NOT INTERFERE WITH NORMAL PRODUCTION ACTIVITIES. CONTRACTOR SHALL COORDINATE ANY WORK TO BE PERFORMED WITH THE SHOP SUPERVISOR TO MINIMIZE IMPACT THE FRC EAST PRODUCTION OPERATION AND INTERFERE WORKLOAD OF THE SHOP.

ALL POWER OUTAGES AND ANY OTHER SUCH WORK THAT COULD CAUSE INTERFERENCE WITH NORMAL PRODUCTION ACTIVITIES SHALL BE SCHEDULED AND COMPLETED ON WEEKENDS AND HOLIDAYS.

POWER OUTAGES REQUEST SHALL BE SUBMITTED A MINIMUM 2 WEEKS (14 DAYS) IN ADVANCE FOR FRC EAST UTILITY AND PRODUCTION CONCURRENCE AND APPROVAL.
- D2. THE CONTRACTOR SHALL CLEAN UP AND DISPOSE OF ANY AND ALL WASTE IN ACCORDANCE WITH ALL LOCAL, STATE, AND FEDERAL REGULATIONS THAT WAS GENERATED IN THE CONSTRUCTION AT THE FACILITY. THE AREA SHALL BE KEPT CLEAN AT ALL TIMES TO PREVENT FOREIGN OBJECT DEBRIS (FOD) IN ACCORDANCE WITH FRCEASTINST 4790.11H.
- D3. REMOVE THE EXISTING PULL BOX AND CONDUIT SECTION TO THE FIRST CONDUIT CONNECTION FITTING. PROVIDE AND INSTALL APPROPRIATE GALVANIZED CONDUIT THREADED CAP FOR THE EXISTING CONDUIT. PATCH AND SEAL THE WALL PENETRATION WITH CONCRETE.
- D4. REMOVE THE EXISTING CONDUITS, PULL BOXES, CONDUIT HANGAR AND ASSOCIATED MOUNTING HARDWARES.
- D5. REMOVE THE EXISTING WIRINGS FROM HYDRAULIC MOTOR CONTROLLER BACK TO SOURCE.
- D6. 1. VERIFY AND REPAIR ALL CONDUIT FITTINGS AND CONNECTIONS OF THE EXISTING CONDUIT RUNS TO ENSURE THAT THEY ARE CONNECTED PROPERLY.
2. PROVIDE CONDUIT SUPPORT, HANGAR, BRACKET AND ASSOCIATED MOUNTING HARDWARES AS NECESSARY FOR THE EXISTING CONDUIT RUN TO SECURE PROPERLY.

ZONE	REV	DESCRIPTION	DATE	APPR



DESIGNER	D.L. INGO
DRAWN	D.L. INGO
CHECKED	A. WETHERINGTON
REVIEWED	J. WINSKIUS
OSH	D. PATTERSON
FIRE DEPT	K. PROCILOVENS
ENR/IR	N/A
APPROVED	M. MARAKIS

FLEET READINESS CENTER EAST	
U.S. MARINE CORPS AIR STATION, CHERRY POINT, N.C.	
ELECTRICAL SERVICE FOR	
CENTRAL HYDRAULIC SYSTEM IN BLDG 137	
(EXISTING)	
REV.	PE-21370P

BUILDING 137	
SHOP 94304	
SIZE	CODE IDENT. NO.
D	96916
PE-21370P	
SCALE: NONE	
FP # 80688	
SHEET 4 OF 8	

8 7 6 5 4 3 2 1